


* 1.5% OR FLATTER RECOMMENDED FOR DESIGN/FORMWORK (2% MAX.)

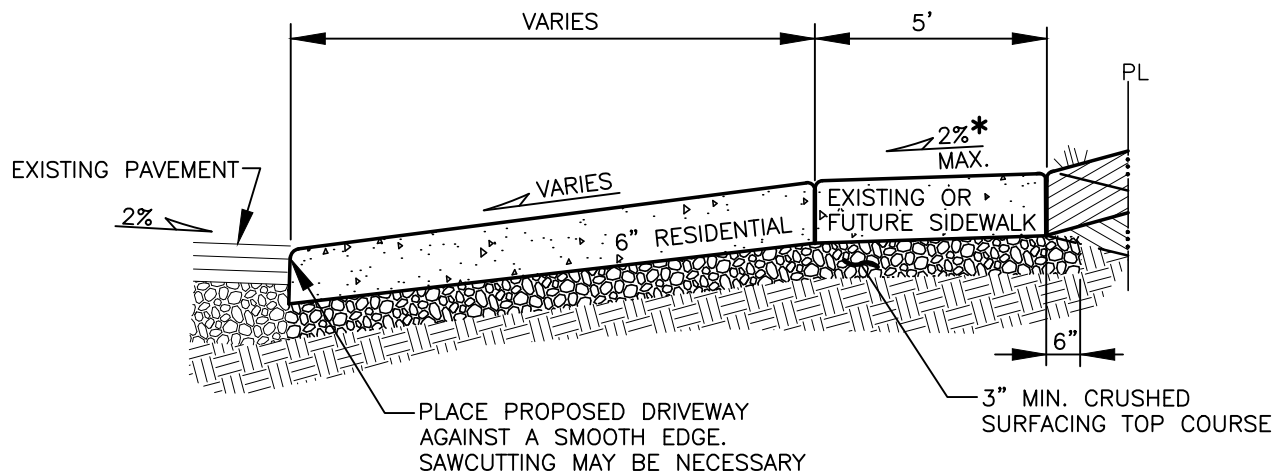

SECTION A-A

NOTES:

1. CONCRETE SHALL BE 4000 PSI MIN. (CL 4000), 3-1/2" SLUMP (MAX.), MEDIUM BROOM FINISH PARALLEL TO DRIVEWAY CENTERLINE.
2. COMPACT SUBGRADE AND CRUSHED SURFACING TOP COURSE TO 95% OF MAXIMUM DRY DENSITY (3" MIN. DEPTH).
3. DRIVEWAYS EXCEEDING 15' IN TOTAL WIDTH SHALL HAVE ADDITIONAL LONGITUDINAL JOINTS AS DIRECTED. JOINT SPACING SHALL NOT EXCEED 15'. SEE **CONCRETE JOINTS DETAIL T05-02**.
4. STRUCTURAL SECTION OF DRIVEWAY TO BE EXTENDED THROUGH SIDEWALK AREA.
5. 3' WING MIN.
6. NO WATER METERS IN DRIVEWAY APPROACH OR WING.
7. FOR SINGLE FAMILY RESIDENCE DEVELOPMENTS ALONG ROADWAYS WITH OUT CURBS.
8. IF A FIRE HYDRANT OR WATER METER BOX IS SITE NEARBY, THERE SHALL BE A MIN. OF 5' BETWEEN THE EDGE OF CONCRETE (WING) AND THE FIRE HYDRANT ASSEMBLY OR METER BOX.

I:\CITYPPS\AUTOCAD\STD_DETAILS\DRAWING_FILES\T01-04B

REV NO.	DATE	BY	APPR	PUBLIC WORKS - STREETS AND TRANSPORTATION
1	8/08	RAW	MHA	
2	7/14	RAW	MHA	
3	1/15	RAW	MHA	
4	3/17	RAW	MHA	
5	4/18	RAW	MHA	
6	9/21	RAW	MHA	

APPROVED BY: *M.H. Sedalla*
ENGINEER MANAGER
APPROVED DATE: 9/1/2021



SINGLE FAMILY RESIDENCE DRIVEWAY WITH WINGS AND NO CURB

STANDARD PLAN NUMBER
T01-04B