


NO PARKING FIRE LANE CURB DETAIL
COMMERCIAL & MULTI-FAMILY RESIDENTIAL APPLICATION
 (Not allowed in 1- and 2-family residential zones or along publicly maintained lanes)

Curb paint is red for the entire length of the fire lane. "NO PARKING FIRE LANE" is stenciled with a **3.5** inch minimum height; block white lettering with a minimum of a **.5** inch stroke.

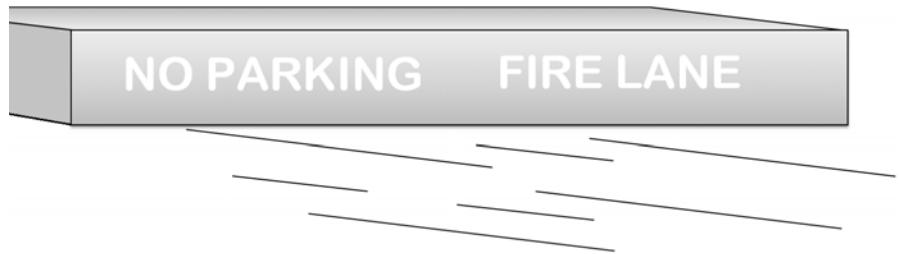

Stencil placement is 20 feet on center and at changes in direction where the lettering may not be visible from a vehicle.

Where fire lane markings are required but curbs are not applicable, signs shall be posted per City of Vancouver Fire Marshal's Office STANDARD PLAN F503-B

Placement standards: NO PARKING FIRE LANE shall be posted wherever parking could obstruct the required minimum 20 foot wide, or wider, fire apparatus access lane.

- Lanes less than 28 feet wide - curbs painted on both sides of lane
- Lanes wider than 28 feet but less than 36 feet wide - curbs painted on one side of the lane (preferably the same side of the lane as the fire hydrants)
- Lanes 36 feet wide or more - curb paint not required by the Fire Department
- Cul-de-sacs less than 43' in paved radius - curb painted around the entire circumference of the cu l-de-sac
- Hammer-heads and other turn-around provisions required for fire apparatus – curbs shall be painted on each side of all lanes within the turn-around



Vancouver Municipal Code Title 16 adopting the International Fire Code including section 503.

VANCOUVER FIRE MARSHAL'S OFFICE

Fire Marshal: Heidi Scarpelli
 Date: 04/15/2015



NO PARKING FIRE LANE
CURB DETAILS

STANDARD PLAN NUMBER

F503-A