
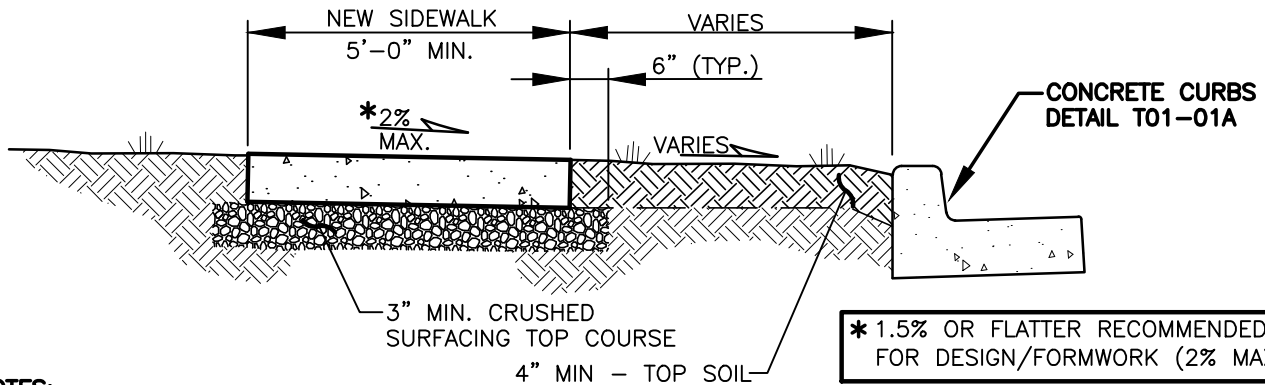
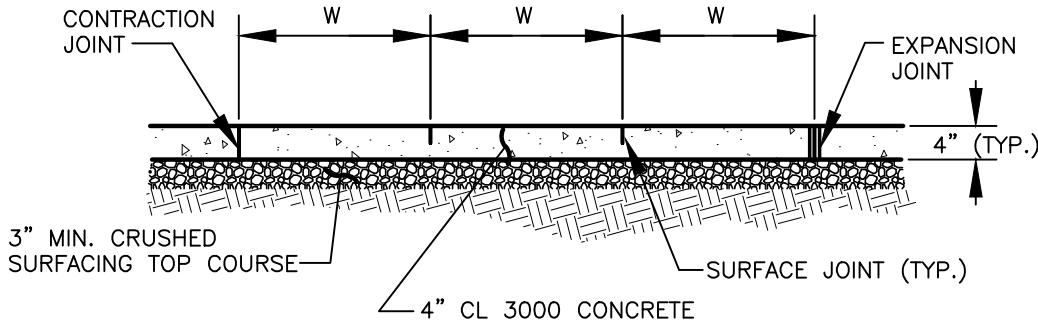


NOMINAL JOINT SPACING:

- ① SURFACE JOINT AT 5'.
- ② CONTRACTION JOINT AT 15'.
- ③ EXPANSION JOINT AT STRUCTURES, OBSTRUCTION, OR AS DIRECTED BY THE INSPECTOR.

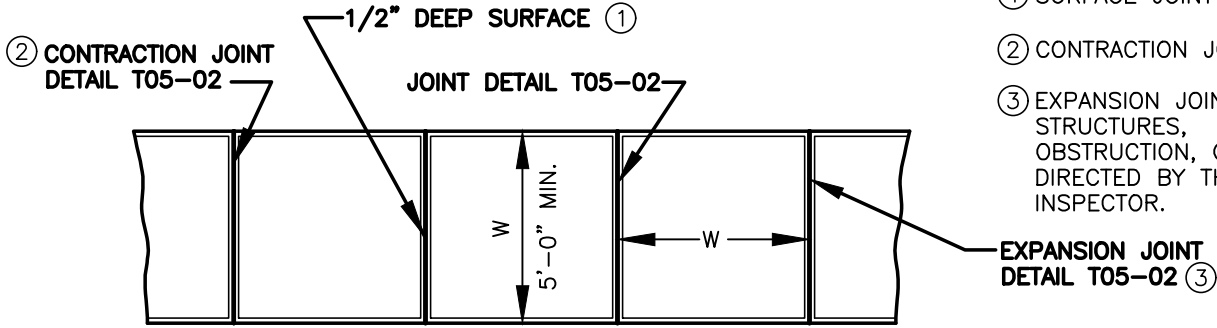

NOTES:

1. CONCRETE SHALL BE 3000 PSI MIN. (CL 3000), 3 1/2" SLUMP (MAX.).
2. COMPACT SUBGRADE AND CRUSHED SURFACING TOP COURSE TO 95% OF MAXIMUM DRY DENSITY (3" MIN. DEPTH).
3. FINISH SHALL BE MEDIUM BROOM PERPENDICULAR TO PEDESTRIAN TRAFFIC UNLESS OTHERWISE DIRECTED.
4. 2" SMOOTH FINISH BORDER AROUND EACH SIDEWALK PANEL OR MATCH EXISTING BORDER.
5. SEE **CONCRETE JOINTS DETAIL T05-02** FOR SURFACE, CONTRACTION, AND EXPANSION JOINTS.
6. ALL EXISTING EDGES SHALL BE SAWCUT.
7. CROSS SLOPE OF PLANTER STRIP SHALL BE 2% (TYP.) AND 4:1 (MAX.).
8. ALL SIDEWALK REMOVAL AND REPLACEMENT SHALL BE JOINT TO JOINT.
9. SIDEWALK REPLACEMENT AREAS SHALL BE ROCKED LEVEL AND COMPACTED UNTIL CONCRETE IS PLACED.
10. FIRE HYDRANT OR WATER METER BOX SHALL NOT BE WITHIN THE SIDEWALK.
11. WHERE ROLLED CURB IS USED WITH ATTACHED SIDEWALKS, SIDEWALK SHALL BE A MIN. OF 6" IN DEPTH.

I:\CITYAPPS\AUTOCAD\STD_DETAILS\DRAWING_FILES\T02-01A.DWG



SIDEWALK DETAIL

CITY OF VANCOUVER
DEPARTMENT OF PUBLIC WORKS
TRANSPORTATION DIVISION

DRAWN BY	APPROVED BY	APPROVAL DATE
CDC	<i>M.H.H.</i>	8/04
REVISION	APPROVED BY	APPROVAL DATE
7	<i>M.H.H.</i>	3/24

STD. PLAN NO.
T02-01A