

DIN RAILS MOUNTED ON SIDE OF CABINET, ENTIRE DEPTH OF CABINET ON BOTH OUTSIDE FRAMES OF 19-IN RACK (4 TOTAL)

DOOR SWITCHES FOR CABINET INTERNAL LIGHTING FRONT AND BACK

30 RACK UNITS

12-POSITION 19-IN RACK MOUNT ELECTRICAL OUTLET BAR WITH CIRCUIT BREAKER


GIGABIT ETHERNET SWITCHES AS REQUIRED BY THE SPECIAL PROVISIONS

20 RACK UNITS


ETHERNET SWITCHES OR POE DEVICES AS REQUIRED BY THE SPECIAL PROVISIONS

10 RACK UNITS

PULL OUT DRAWER SHALL OPEN TO THE FRONT, WITH FULL CONNECTION TO ALL FOUR POSTS OF 19-IN RACK

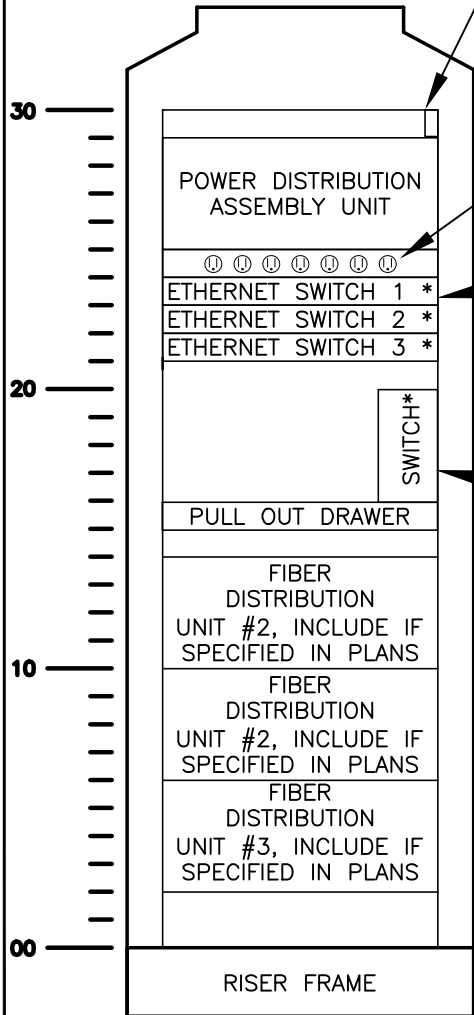

**FOUNDATION FRONT VIEW**

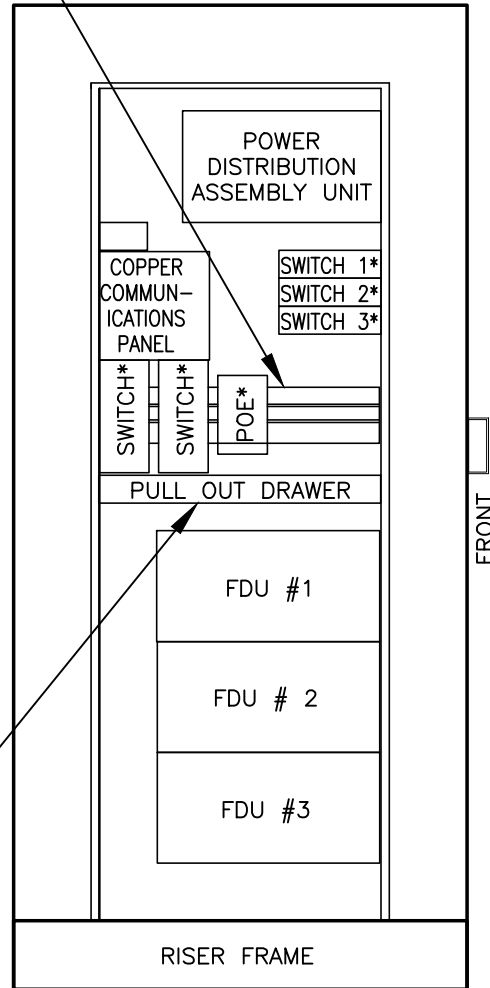

**FOUNDATION SIDE VIEW**

**NOTES:**

1. SEE DETAIL **T22-02B** FOR 334 COMMUNICATIONS POWER DISTRIBUTION ASSEMBLY DETAIL.
2. SEE DETAIL **T22-02C** FOR 334 COMMUNICATIONS WIRING NOTES.
3. SEE DETAIL **T22-02D** FOR 334 COMMUNICATIONS WIRING SCHEMATICS.



**TYPICAL 334 COMMUNICATIONS CABINET INTERIOR**

CITY OF VANCOUVER  
DEPARTMENT OF PUBLIC WORKS  
TRANSPORTATION DIVISION

DRAWN BY	APPROVED BY	APPROVAL DATE
CDC	<i>[Signature]</i>	3/22
REVISION	APPROVED BY	APPROVAL DATE
2	<i>[Signature]</i>	3/24

STD. PLAN NO.  
**T22-02A**