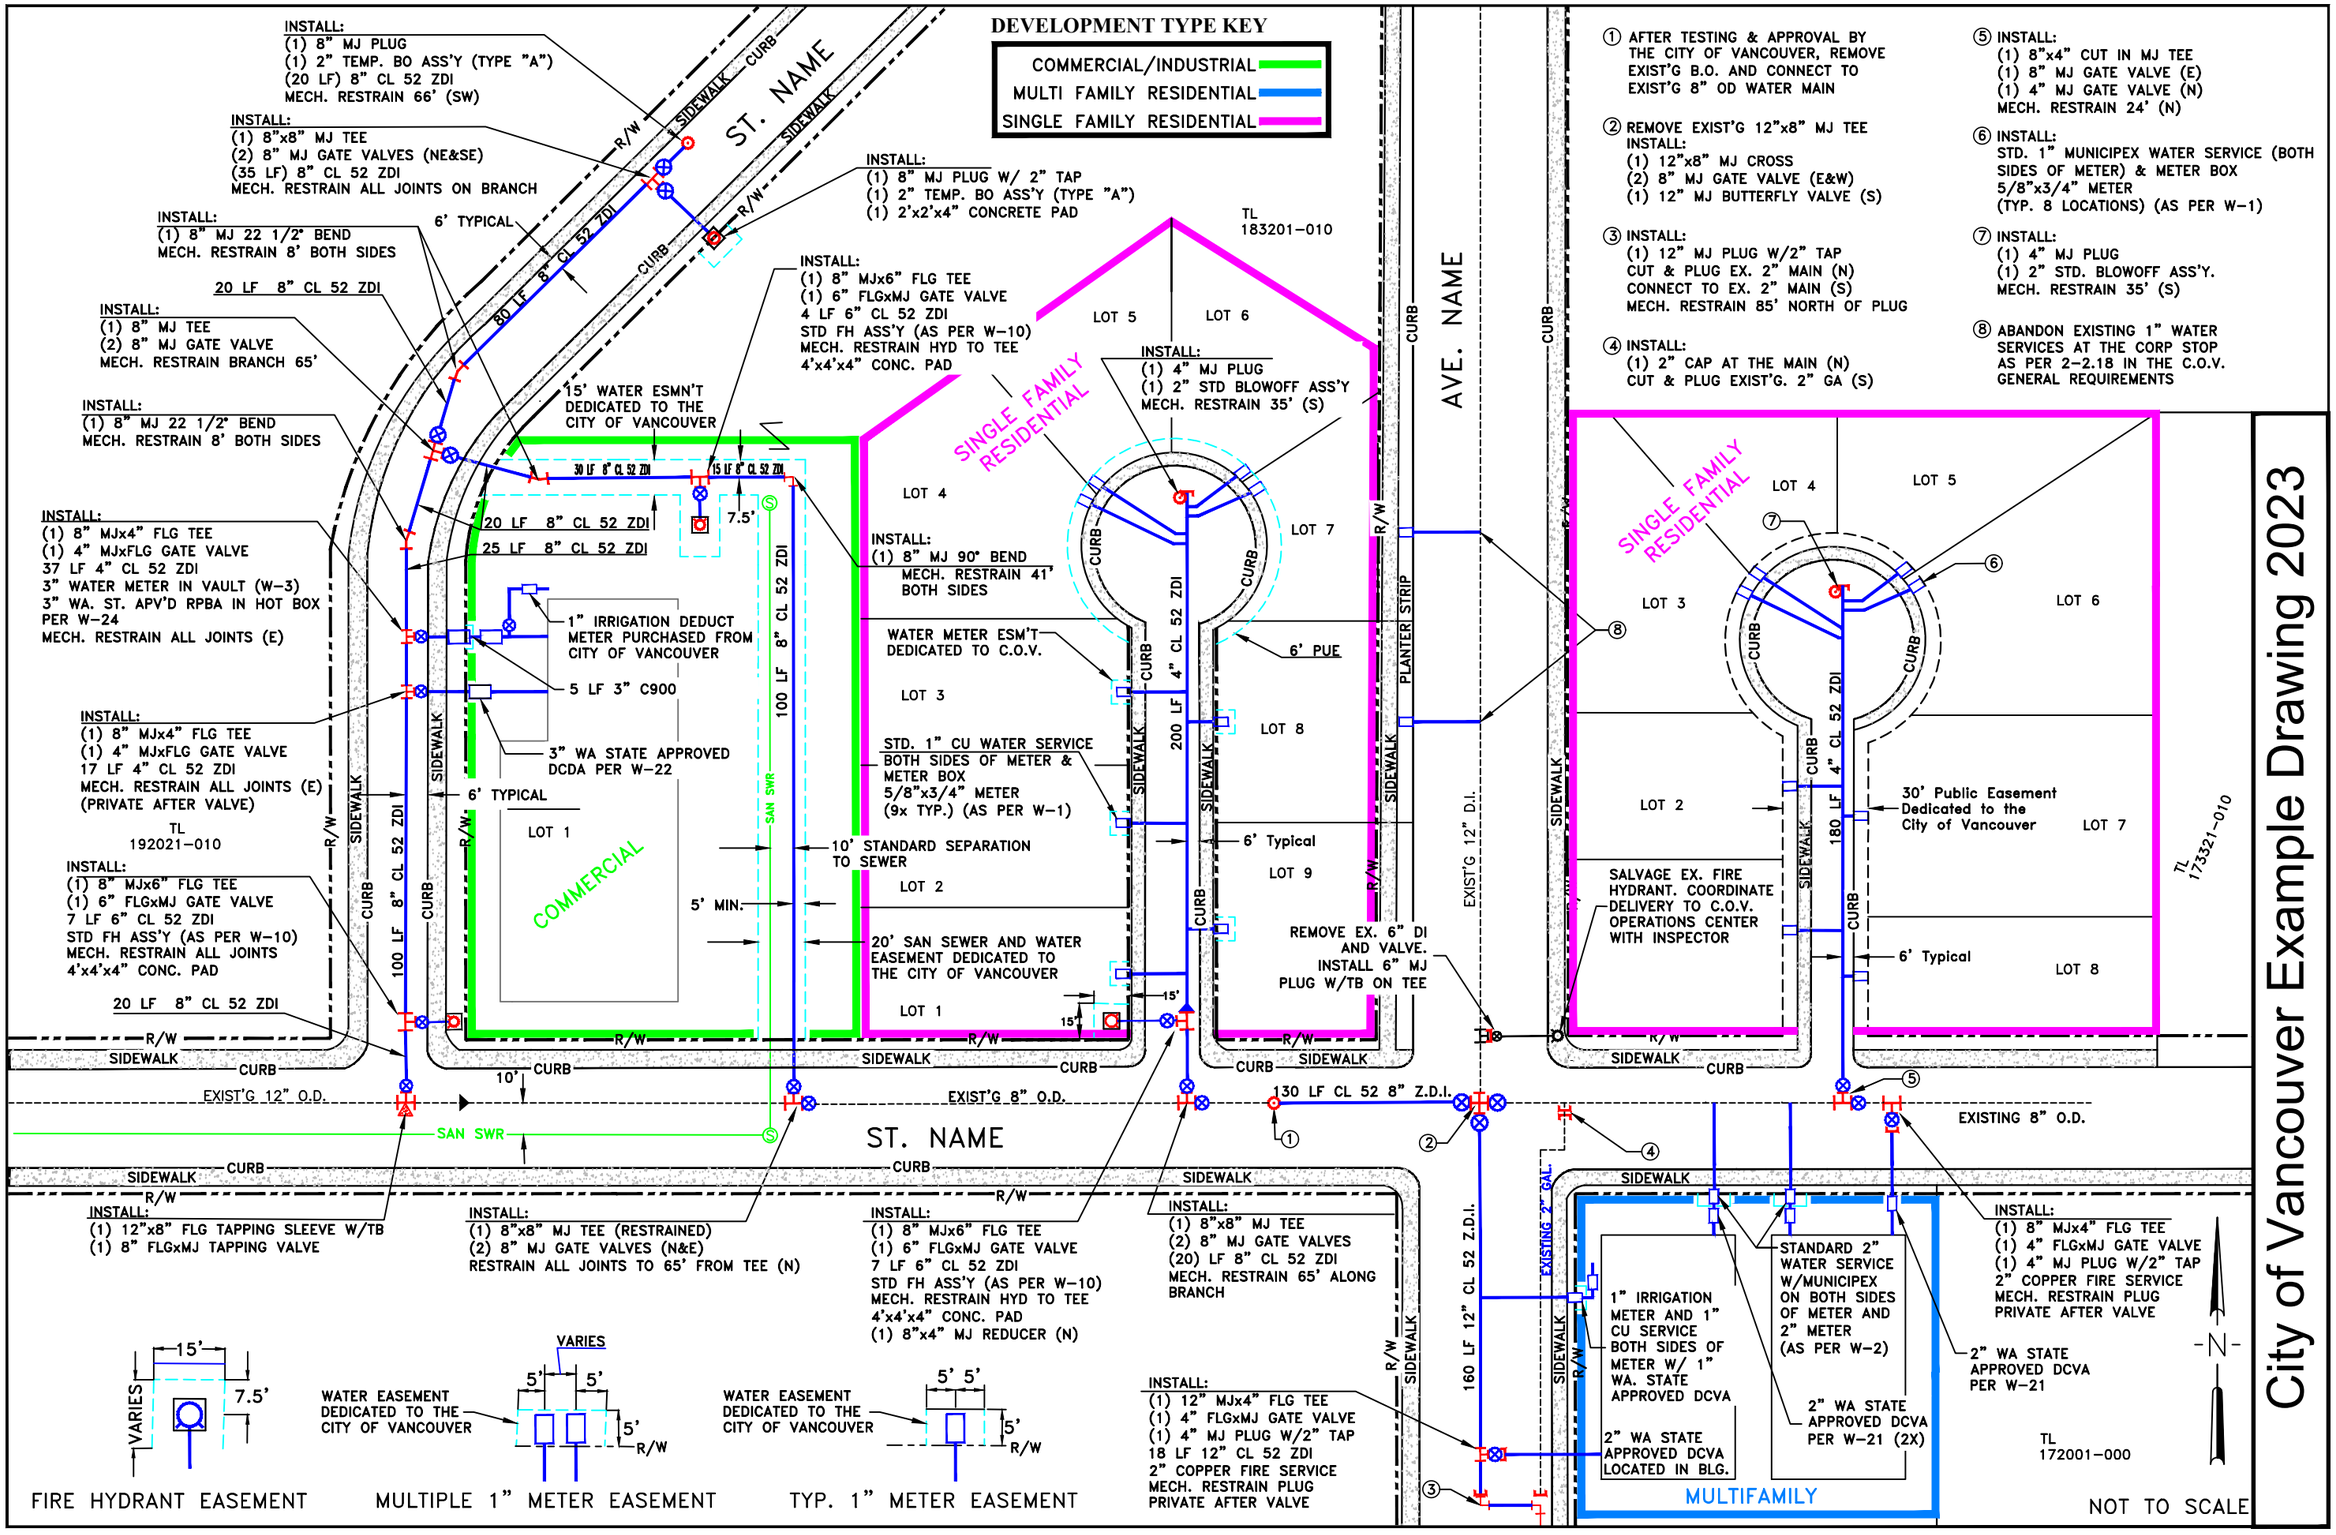

① AFTER TESTING & APPROVAL BY THE CITY OF VANCOUVER, REMOVE EXIST'G B.O. AND CONNECT TO EXIST'G 8" OD WATER MAIN

② REMOVE EXIST'G 12"x8" MJ TEE
INSTALL:
(1) 12"x8" MJ CROSS
(2) 8" MJ GATE VALVE (E&W)
(1) 12" MJ BUTTERFLY VALVE (S)

③ INSTALL:
(1) 12" MJ PLUG W/2" TAP
CUT & PLUG EX. 2" MAIN (N)
CONNECT TO EX. 2" MAIN (S)
MECH. RESTRAIN 85' NORTH OF PLUG

④ INSTALL:
(1) 2" CAP AT THE MAIN (N)
CUT & PLUG EXIST'G. 2" GA (S)

⑤ INSTALL:
(1) 8"x4" CUT IN MJ TEE
(1) 8" MJ GATE VALVE (E)
(1) 4" MJ GATE VALVE (N)
MECH. RESTRAIN 24' (N)

⑥ INSTALL:
STD. 1" MUNICIPEX WATER SERVICE (BOTH SIDES OF METER) & METER BOX
5/8"x3/4" METER
(TYP. 8 LOCATIONS) (AS PER W-1)

⑦ INSTALL:
(1) 4" MJ PLUG
(1) 2" STD. BLOWOFF ASS'Y.
MECH. RESTRAIN 35' (S)

⑧ ABANDON EXISTING 1" WATER SERVICES AT THE CORP STOP AS PER 2-2.18 IN THE C.O.V. GENERAL REQUIREMENTS

City of Vancouver Example Drawing 2023